



Top View

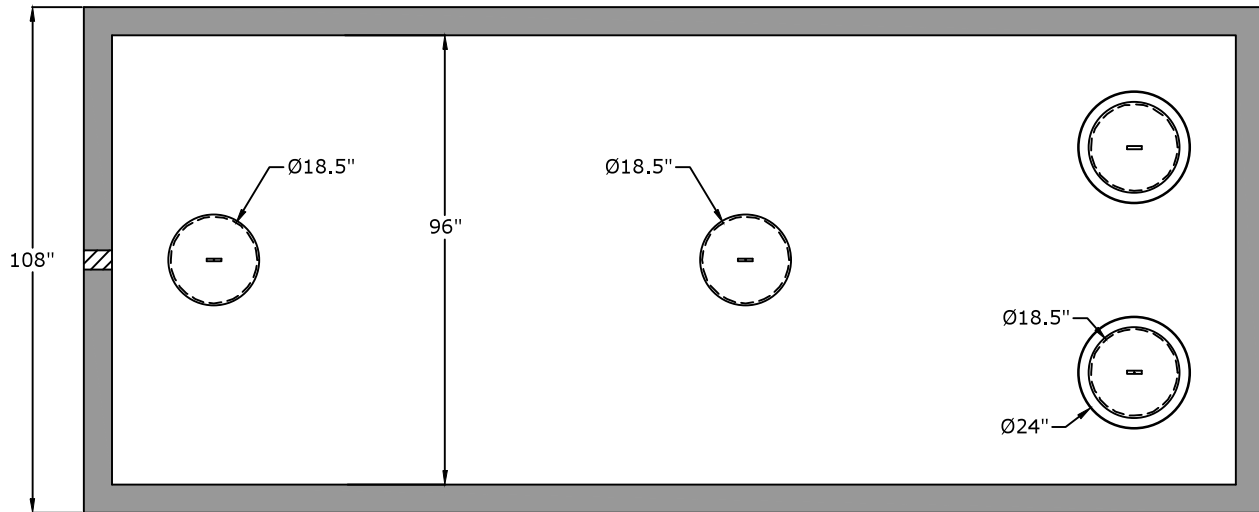

Side View

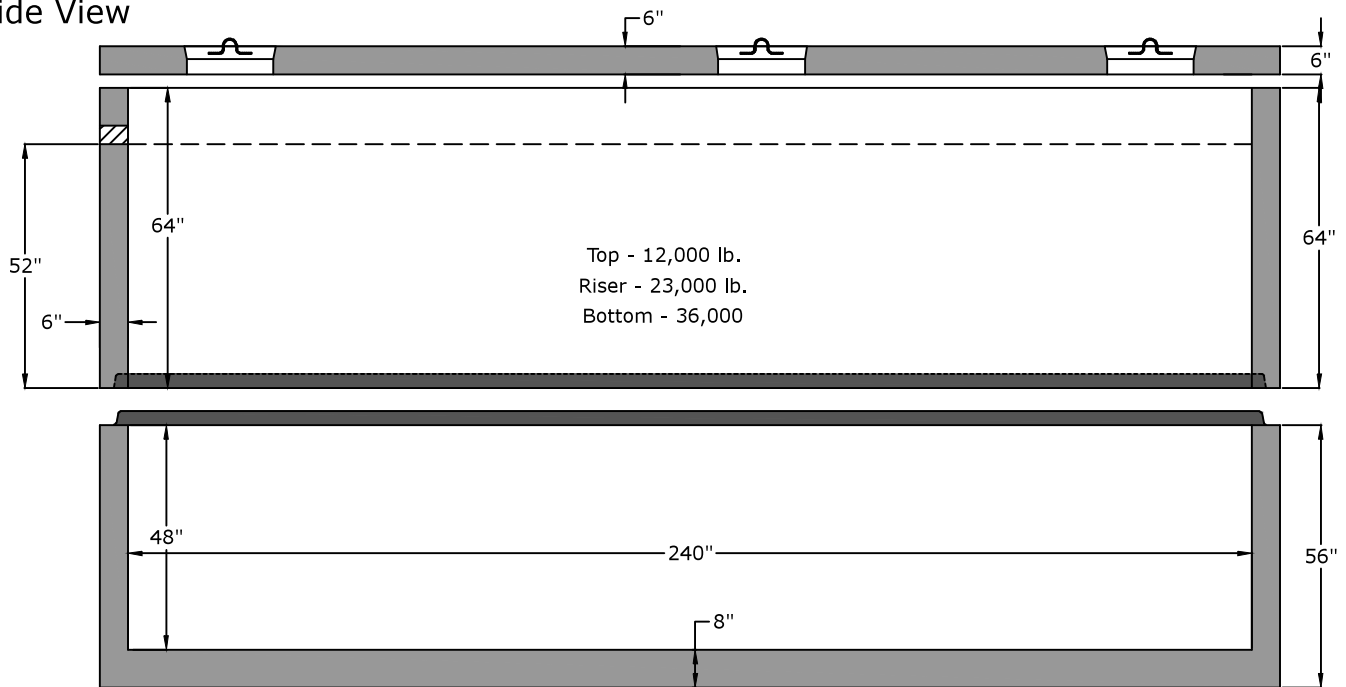

Approved for Production

Project: _____ Date: _____

Quantity: _____ By: _____



C.R. Barger & Sons, Inc.
P.O. Box 370 - Kingston TN 37763
Phone 888.882.5860 - BargerAndSons.com

Specifications

- Concrete:** 5,000 psi minimum strength (28 day)
- Reinforcement:** Per ASTM C 1227
- Reinforcing:** Primary reinforcement will be top, side, and bottom #4 & #5 rebar (Grade 60) rebar.
- Sealant:** Sealant used in the seam of the tank will meet or exceed ASTM C990.
- Pipe Penetrations:** Inlet and outlets are fitted with seals that meet or exceed ASTM C923 specifications.

**10,000 Gallon Pump Tank
Duplex**

Date: 1.192011

Drawn By: Eric Barger

Approx. Weight: See above